


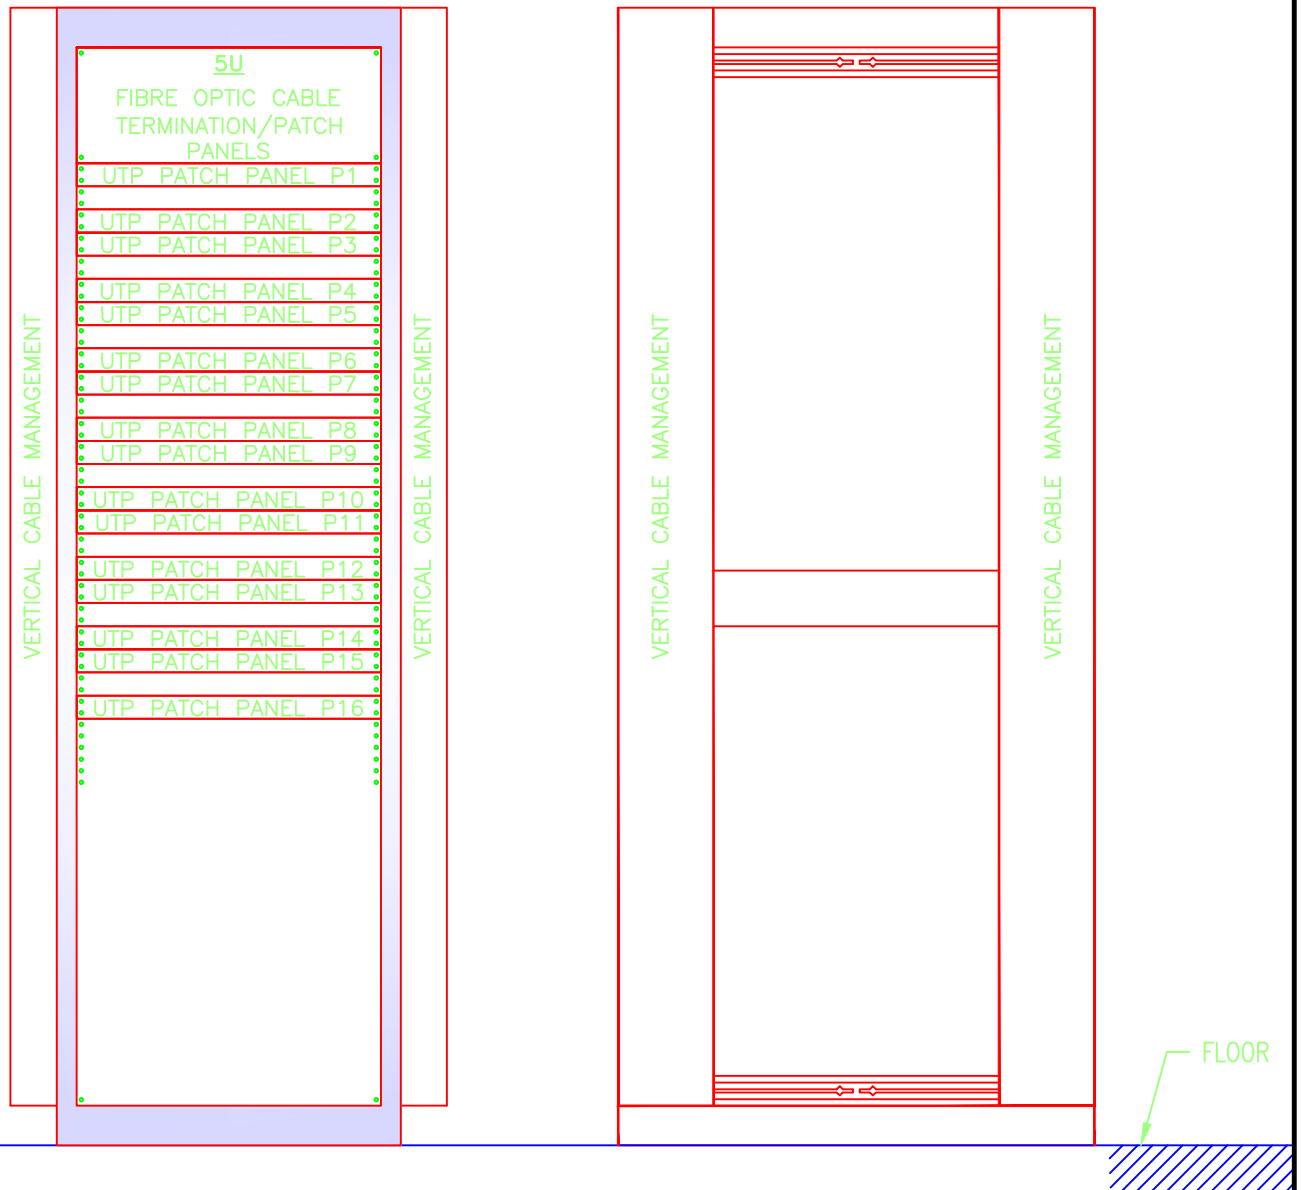

NOTES:

1. FINAL DETAILS ARE DETERMINED AT TIME OF INSTALLATION WITH UBC INFORMATION TECHNOLOGY.
2. INSTALL ADDITIONAL RACK WHEN MORE TERMINATION SPACE THEN SHOWN IS NEEDED.
3. MAXIMUM CABLE COUNT PER RACK IS 384, EQUIVALENT TO 8-48 PORT SWITCHES, 16-24 PORT PATCH PANELS.

Sheet No.

1 of 1

	BY	DATE
Drawn	DE	JULY 2025
Checked		
Design'd	TZ	JULY 2025
Approved	EB	JULY 2025

EQUIPMENT CABINET (SINGLE OR FIRST) TYPICAL EQUIPMENT PLACEMENT



THE UNIVERSITY OF BRITISH COLUMBIA
Information Technology

File No.

ITSTD-15

Rev.

0