


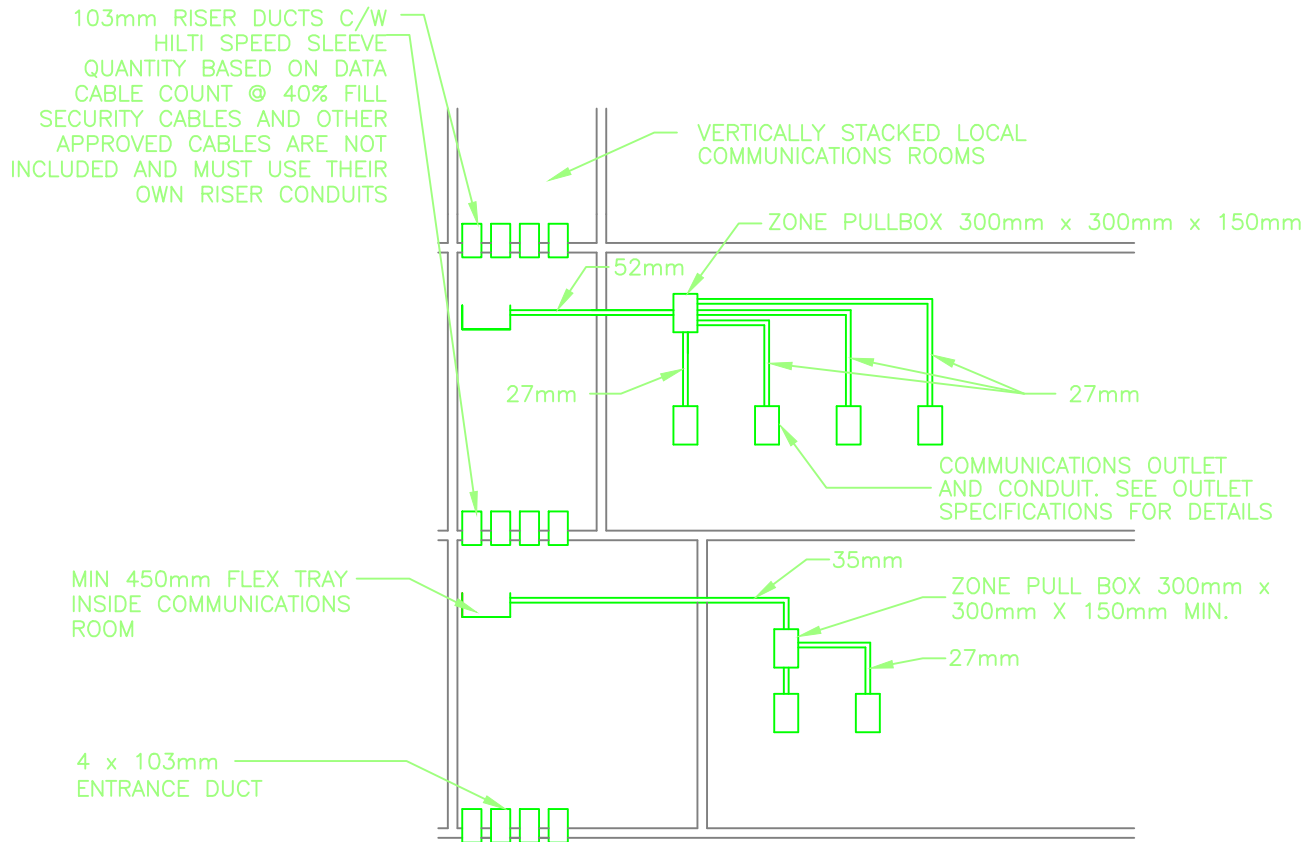

NOTES:

1. DEFAULT CONDUIT SIZE SHALL BE 27mm
2. MINIMUM ZONE PULLBOX SIZE IS 300mm X 300mm x 150mm
3. APPROPRIATELY SIZED ZONE CONDUIT BASED ON 40% FILL RATIO
4. DAISY CHAIN OF OUTLET BOXES IS NOT ALLOWED
5. 21mm CONDUIT IS ACCEPTABLE IN SPECIFIC CIRCUMSTANCES (SEE 2705 28-1.6.8.7)
6. OUTLET BOX: DUAL GANG DEEP (MDB2) OR 4x4 WITH APPROPRIATE MUD RING

Sheet No.

1 of 1

	BY	DATE
Drawn	DE	JULY 2025
Checked		
Design'd	TZ	JULY 2025
Approved	EB	JULY 2025

COMMUNICATION ZONE PATHWAYS IN ACADEMIC BUILDING (TYPICAL)



THE UNIVERSITY OF BRITISH COLUMBIA
Information Technology

File No.

ITSTD-19

Rev.

0