
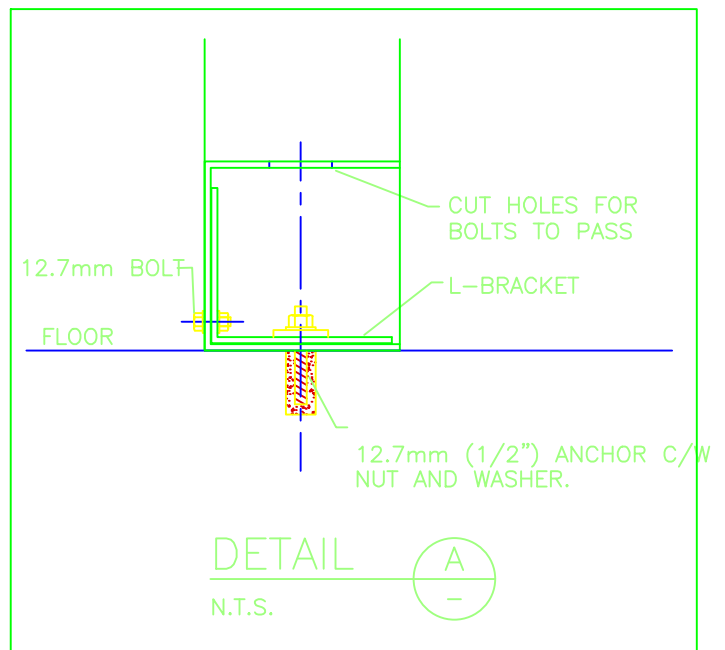


MASONRY BLOCK WALL.

HILTI HIT HY20 – A 12.7mm (½")x115

75x230x75 – SHAPE STEEL BRACKET

12.7mm (½") BOLT

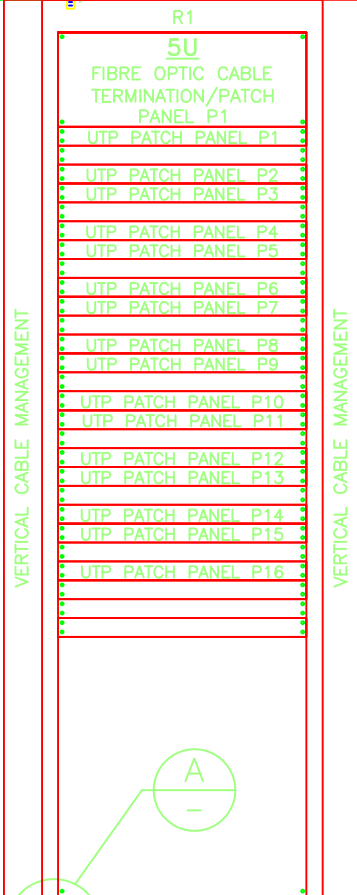

FLOOR

BOLT EQUIPMENT RACK TO FLOOR

SEISMIC RESTRAINED RACK

N.T.S.

Sheet No.

1 of 1

	BY	DATE
Drawn	DE	SEPT 2025
Checked		
Design'd	TZ	SEPT 2025
Approved	EB	SEPT 2025

SEISMIC RESTRAIN DETAILS FOR DATA CABINETS (TYPICAL)



THE UNIVERSITY OF BRITISH COLUMBIA
Information Technology

File No.

ITSTD-36

Rev.

0