


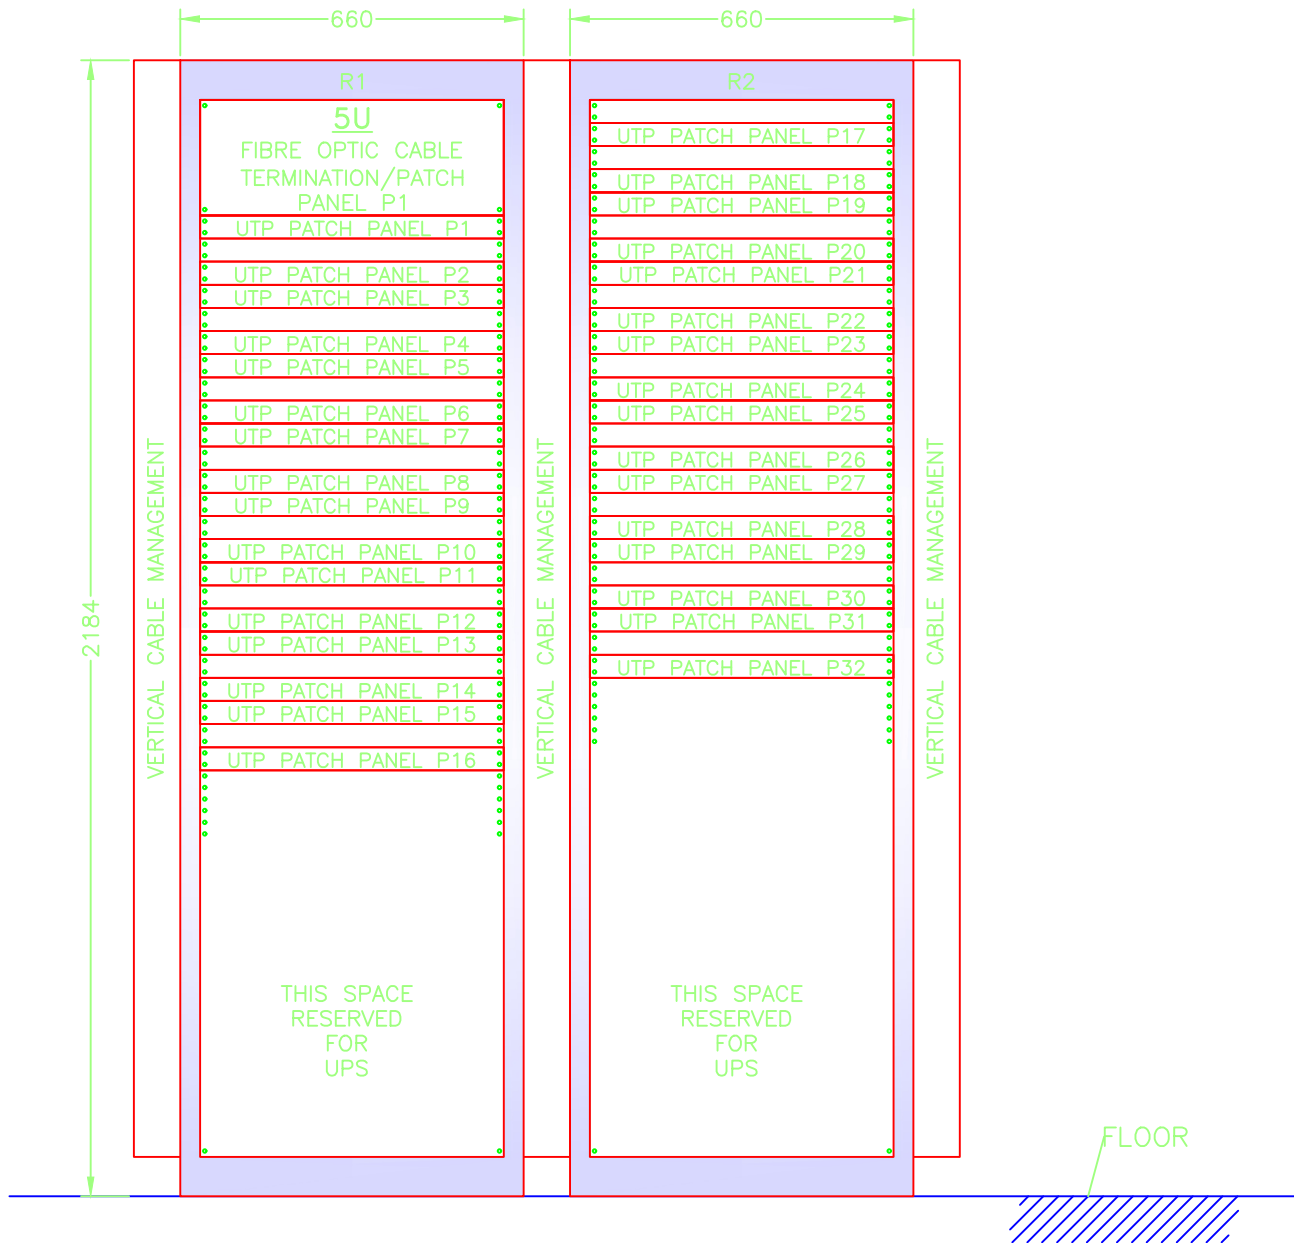

NOTES:

1. WHEN MORE THAN ONE FIBER PATCH PANEL IS PRESENT IN A RACK, THE NUMBER OF COPPER PATCH PANEL SHALL BE REDUCED ACCORDINGLY.
2. THE FIRST FIBRE PATCH PANEL WILL ALWAYS BE 'P1' IN EACH RACK.
3. THE FIRST COPPER PATCH PANEL WILL BE 'P1', CONTINUING CONSECUTIVELY ACROSS ALL RACKS.
4. CONFIRM WITH UBC IT FOR EQUIPMENT CONFIGURATION OF THE SPECIFIC COMMUNICATION ROOM.
5. ONLY 24 PORT PATCH PANELS WILL USED, MAXIMUM OF 16 PANELS DUE TO SWITCH STACK LIMITATIONS
6. ADJACENT RACKS WILL BE BOLTED TO EACH OTHER WITH THE APPROPRIATE VERTICAL CABLE MANAGEMENT PANELS IN BETWEEN THEM.

Sheet No.

1 of 1

	BY	DATE
Drawn	DE	SEPT 2025
Checked		
Design'd	TZ	SEPT 2025
Approved	EB	SEPT 2025

PATCH PANEL NUMBERING TWO EQUIPMENT CABINET LAYOUT



THE UNIVERSITY OF BRITISH COLUMBIA
Information Technology

File No.

ITSTD-60

Rev.

1